



## Application Of Norika Air Testing Tools For High Pressure Test



High Pressure test:  
34kPa/5PSI  
Duration of test:  
15 mins

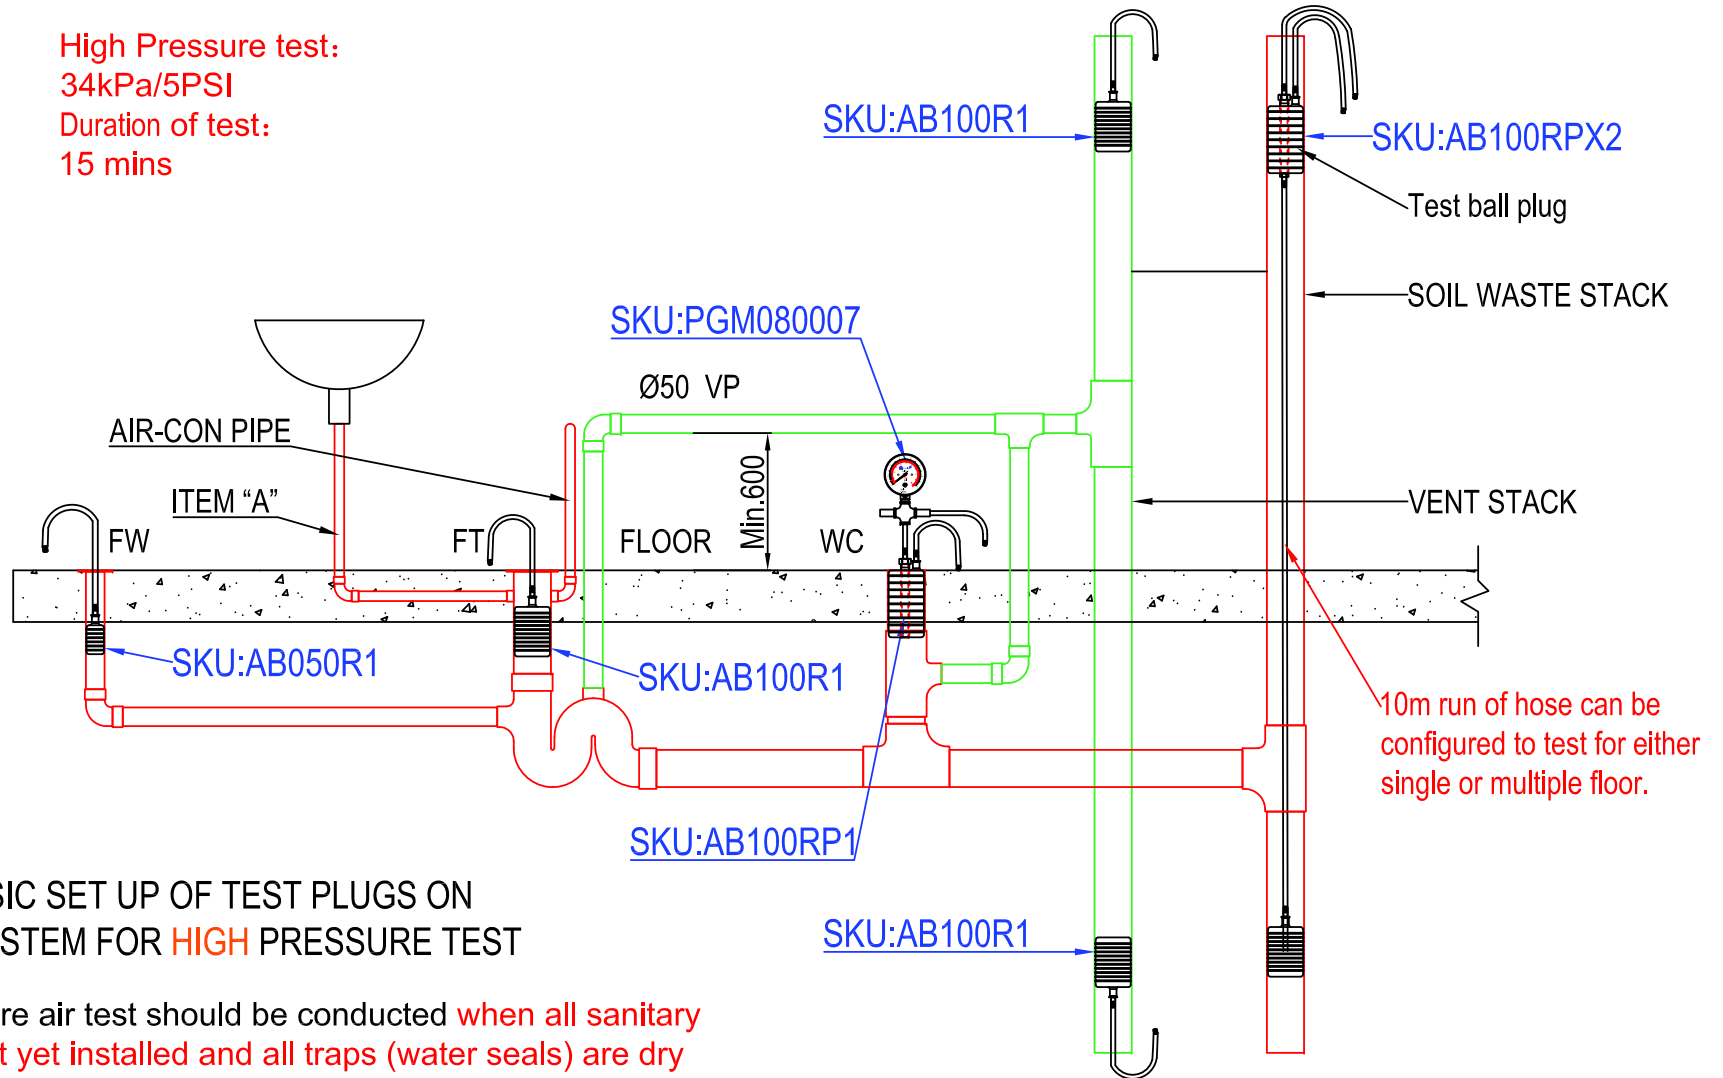


FIG A -BASIC SET UP OF TEST PLUGS ON SANITARY SYSTEM FOR HIGH PRESSURE TEST

Note: High pressure air test should be conducted when all sanitary appliances are not yet installed and all traps (water seals) are dry and sealed before applying high pressure air to the pipework .